


# CONSTRUCTION DRAWING

SCALE 1" = 30'

PAGE 4 OF 17

CONTROL PANEL

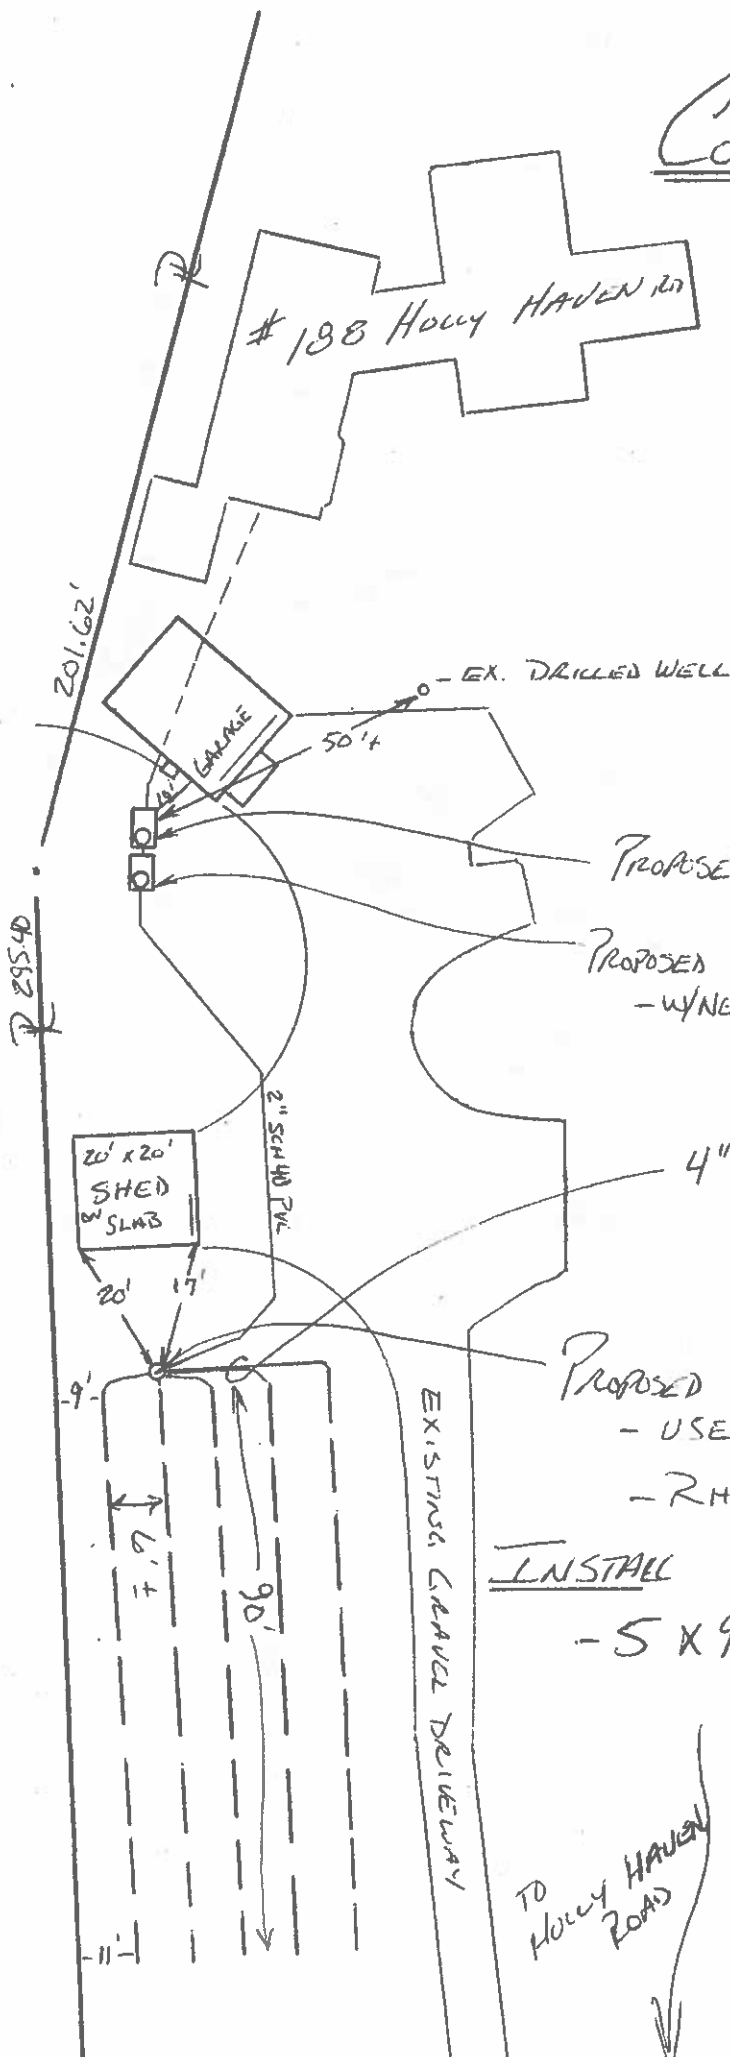

PROPOSED 1250 GALLON TOP SEAM SEPTIC TANK  
- SEE PG. 5 -

PROPOSED 1250 GALLON TOP SEAM PUMP TANK  
- W/NEW CONTROLS - SEE PGS 6-9 -

4" SCH 40 PVC HEADERS

PROPOSED DISTRIBUTION BOX  
- USE FRACO MONSTER BOX  
OR  
- RHINO MANHOLE TYPE BOX

## INSTALL

- 5 X 90' TRENCHES
- 2' WIDE ± 6' CENTERS
- BETWEEN EXISTING TRENCHES
- CONTRACTOR TO SUPPLY 12" COVER OVER TRENCHES
- SCREENED SANDY TOPSOIL REQUIRED.

TO HOLLY HAVEN ROAD



# MILLER'S SERVICES

SEPTIC • PLUMBING • DRAIN CLEANING  
ELECTRICAL • HEATING • COOLING

P.O. Box 1345 | 15457 George Washington Memorial Hwy, Saluda, VA

O: 804-758-4314 | F: 804-758-4316

www.millers-va.com

## Installer Completion Statement

Health Department: Lancaster	HDID #: 151-22-0085	TM #: 27A-1-5
Company Name / License #: Miller's Septic Service, P.O. Box 1345, Saluda, Virginia 23149 Licensed Individual: James Lee Miller Lic#: 1944-001582		

Owner Name: Wayne & Melissa Kerby Address: 188 Holly Haven Rd. Weems, VA 22576
-----------------------------------------------------------------------------------

Location of Installation: 911 Address: 188 Holly Haven Rd. Weems, VA 22576			
Subdivision:	Lot #:	Block:	Section:
Other Description:			

I hereby certify that the onsite sewage disposal system has been installed and completed in accordance with the construction permit issued on {Permit Issue Date}, and is in compliance with Part D of the Sewage Handling and Disposal Regulations (12VAC5-610) and when appropriate the plans and specification for the project.

Signature:  James L. Miller III

Date: 1/17/2023



THREE RIVERS HEALTH DISTRICT  
P.O. BOX 415  
SALUDA, VIRGINIA 23149

### ***OSE Construction Permit Repair***

**Sewage Contractors:** Please notify Health Department and OSE or PE 48 hours prior to installation to arrange for inspection  
**May 31, 2022**

**Wayne and Melissa Kerby**  
**188 Holly Haven Rd.**  
**Weems, Va. 22576**

**RE: Tax Map:** 27A-1-5  
**HDID:** 151-22-0085  
**System Capacity:** Residential; 3 Bedrooms, 450 gallons per day

Dear Mr. & Mrs. Kerby:

This letter and the attached drawings, specifications, and calculations (17 pages) dated 5/11/22, constitute your permit to connect to a sewage disposal system and well if applicable on the property referenced above. Your application for a permit was submitted pursuant to §32.1-163.5 of the Code of Virginia, which requires the Health Department to accept private soil evaluations and designs from an Onsite Soil Evaluator (OSE) or a Professional Engineer working in consultation with an OSE for residential development. VDH is not required to perform a field check to verify the private evaluations of OSEs or PEs and such a field check may not have been conducted for the issuance of this permit.

The soil absorption area ("site"), sewage system design, and the well location and construction if applicable were certified by Daniel F. Josselyn, Private OSE as substantially complying with the Board of Health's regulations (and local ordinances if the locality has authorized the local health department to accept private evaluations for compliance with local ordinances). This permit is issued in reliance upon that certification. VDH hereby recognizes that the soil and site conditions acknowledged by this permit are suitable for the installation of an onsite sewage system. This construction permit is null and void if any substantial physical change in the soil or site conditions occurs where a sewage disposal system is to be located.

If modifications or revisions are necessary between now and when you construct your dwelling, please contact the OSE/PE who performed the evaluation and design on which this permit is based. Should revisions be necessary during construction, your contractor should consult with the OSE/PE that submitted the site evaluation or site evaluation and design. The OSE/PE is authorized to make minor adjustments in the location or design of the system at the time of construction provided adequate documentation is provided to the Three Rivers Health District.

The OSE/PE that submitted the certified design for this permit is required to conduct a final inspection of this sewage system when it is installed and to submit an inspection report and completion statement. As the owner, you are responsible for giving reasonable notice to the OSE/PE of the need for a final inspection. If the designer is unable to perform the required inspection, you may provide an

inspection report and completion statement executed by another OSE/PE. The Three Rivers Health District is not required to inspect the installation but may perform an inspection at its sole discretion. No part of this installation shall be covered until it has been inspected by the OSE/PE as noted herein. The sewage system may not be placed into operation until you have obtained an Operation Permit from the Three Rivers Health District.

This Construction Permit is null and void if conditions are changed from those shown on your application or if conditions are changed from those shown on the Site and Soil Evaluation Report and the attached construction drawings, specifications, and calculations. VDH may revoke or modify any permit if, at a later date, it finds that the site and soil conditions and/or design do not substantially comply with the Sewage Handling and Disposal Regulations, 12 VAC 5-610-20 et seq., or if the system would threaten public health or the environment.

This permit approval has been issued in accordance with applicable regulations based on the information and materials provided at the time of application. There may be other local, state, or federal laws or regulations that apply to the proposed construction of this onsite sewage system. The owner is responsible at all times for complying with all applicable local, state, and federal laws and regulations. This construction permit is transferrable until expired or deemed null and void. A permit transfer form may be found on the VDH website at <http://www.vdh.virginia.gov/environmental-health/gmp-2015-01-forms/>.

If you have any questions, please contact me at (804)-462-9919.

This permit expires: November 31, 2023.

Sincerely,

A handwritten signature in blue ink, appearing to read "George Sanford", is written over a horizontal line.

George Sanford,  
Environmental Health Specialist, Sr.  
Three Rivers Health District

CC: Private OSE